


LINT SCREENS AND COOLING PIT SEPARATE UNITS

FOR MORE INFORMATION REFER TO OUR WEBSITE
watercorporation.com.au/tradewaste

GUIDELINES

1. LINT SCREENS AND BASKETS ARE TO BE SIZED APPROPRIATELY TO FLOW RATES FROM LAUNDRY AT THE DESIGN STAGE BY A HYDRAULIC CONSULTANT.
2. COOLING PITS ARE TO BE INSTALLED TO REDUCE THE TEMPERATURE OF WASTE TO MAX. 38°C, MEASURED AT THE TRADE WASTE SAMPLING POINT. REFER TO TYPICAL DRAWING HX33-18-50.
3. TRADE WASTE MONITORING POINT TO BE INSTALLED DOWNSTREAM OF PRE-TREATMENT FIXTURE. REFER TO PUB11 AND TYPICAL DRAWING HX33-20-00.
4. ALL LAUNDRY WASTE ARE TO DISCHARGE VIA TRADE WASTE SAMPLING POINT (REFER TO TYPICAL DRAWING HX33-11-30) DOWNSTREAM OF FLOWMETER AND WITHIN MAX. 2 METRES OF EXTERNAL PULSE PLUG AND GENERAL PURPOSE POWER POINT.
5. AIR ADMITTANCE VALVE SHALL NOT BE USED IN CONNECTION WITH TRADE WASTE PRE-TREATMENT FIXTURES.
6. ALL ASSOCIATED PLUMBING WORK IS TO COMPLY WITH THE PLUMBERS LICENSING AND PLUMBING STANDARDS REGULATIONS 2000 (THE PLUMBING REGULATIONS) (AS AMENDED)
7. COOLING PIT/LINT TRAP TO BE A WATER CORPORATION APPROVED PRODUCT. REFER WATER CORPORATION WEBSITE FOR LIST OF APPROVED PRODUCTS
8. TRADE WASTE SAMPLING POINT DESIGN LOCATION AND ACCESSIBILITY MUST NOT CONSTITUTE A HEALTH & SAFETY RISK

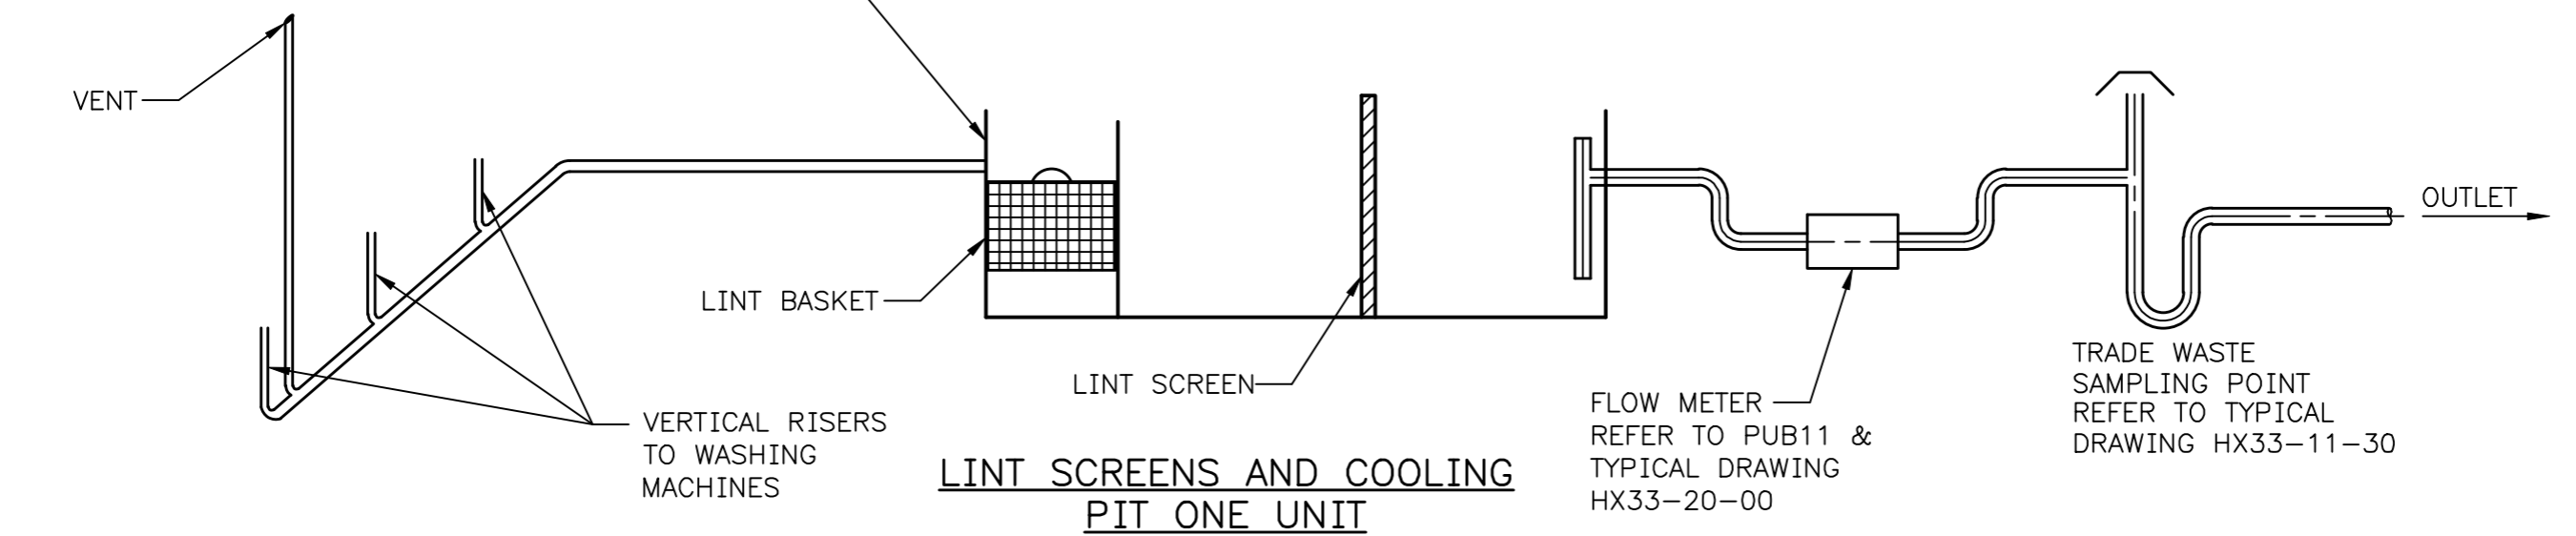

LINT SCREENS AND COOLING PIT ONE UNIT

ISSUE	DATE	GRID	REVISION	DRN	REC	APPD
E	05/2024		NOTE 8 ADDED, NOTE 6 UPDATED	JD	NT	MS
D	02/2020		PLUMBING REGULATIN TITLE UPDATED, NOTE 7 ADDED, NOTES 2,3 AND 4 CHANGED	JMS	NT	MS
C	07/2016		WEBSITE DETAILS ADDED, GUIDELINES AMENDED	BJ	SJ	MS
B	06/2009		NOTES 5 & 6 ADDED	RJ	GC	AM

SCALE: DIAGRAMMATIC

DES CALC	RECOMMENDED	01/08/2005		WATER CORPORATION TYPICAL DRAWINGS FOR TRADE WASTE COMMERCIAL LAUNDRIES	ORIGINAL SHEET SIZE
DES CHD	A MANZINGER				A3
DRN	APPROVED	01/08/2005	FILE 58584709 PROJECT	PLAN HX33-18-60	CAD ISSUE E MF
K MCGREGOR	J HEWITT				
Q.C. CHD	MANAGER, INDUSTRIAL WASTES				
G CLEAVER					