
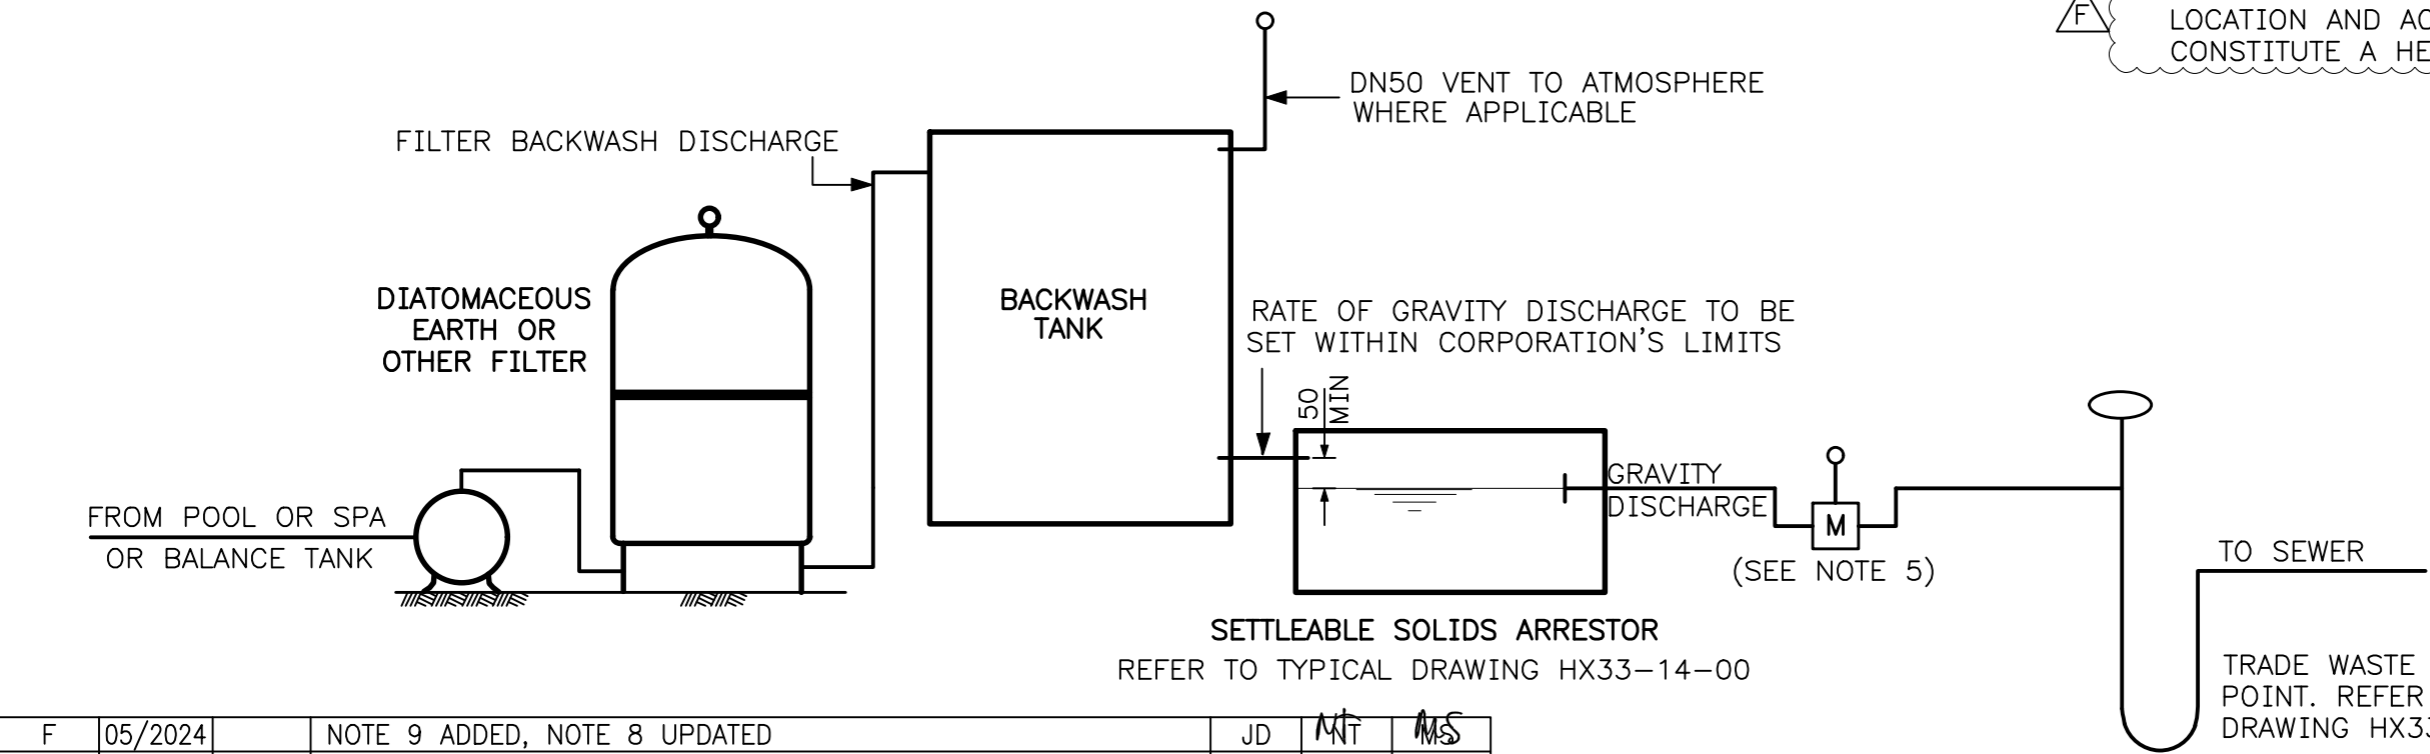


FOR MORE INFORMATION REFER TO OUR WEBSITE
watercorporation.com.au/tradewaste

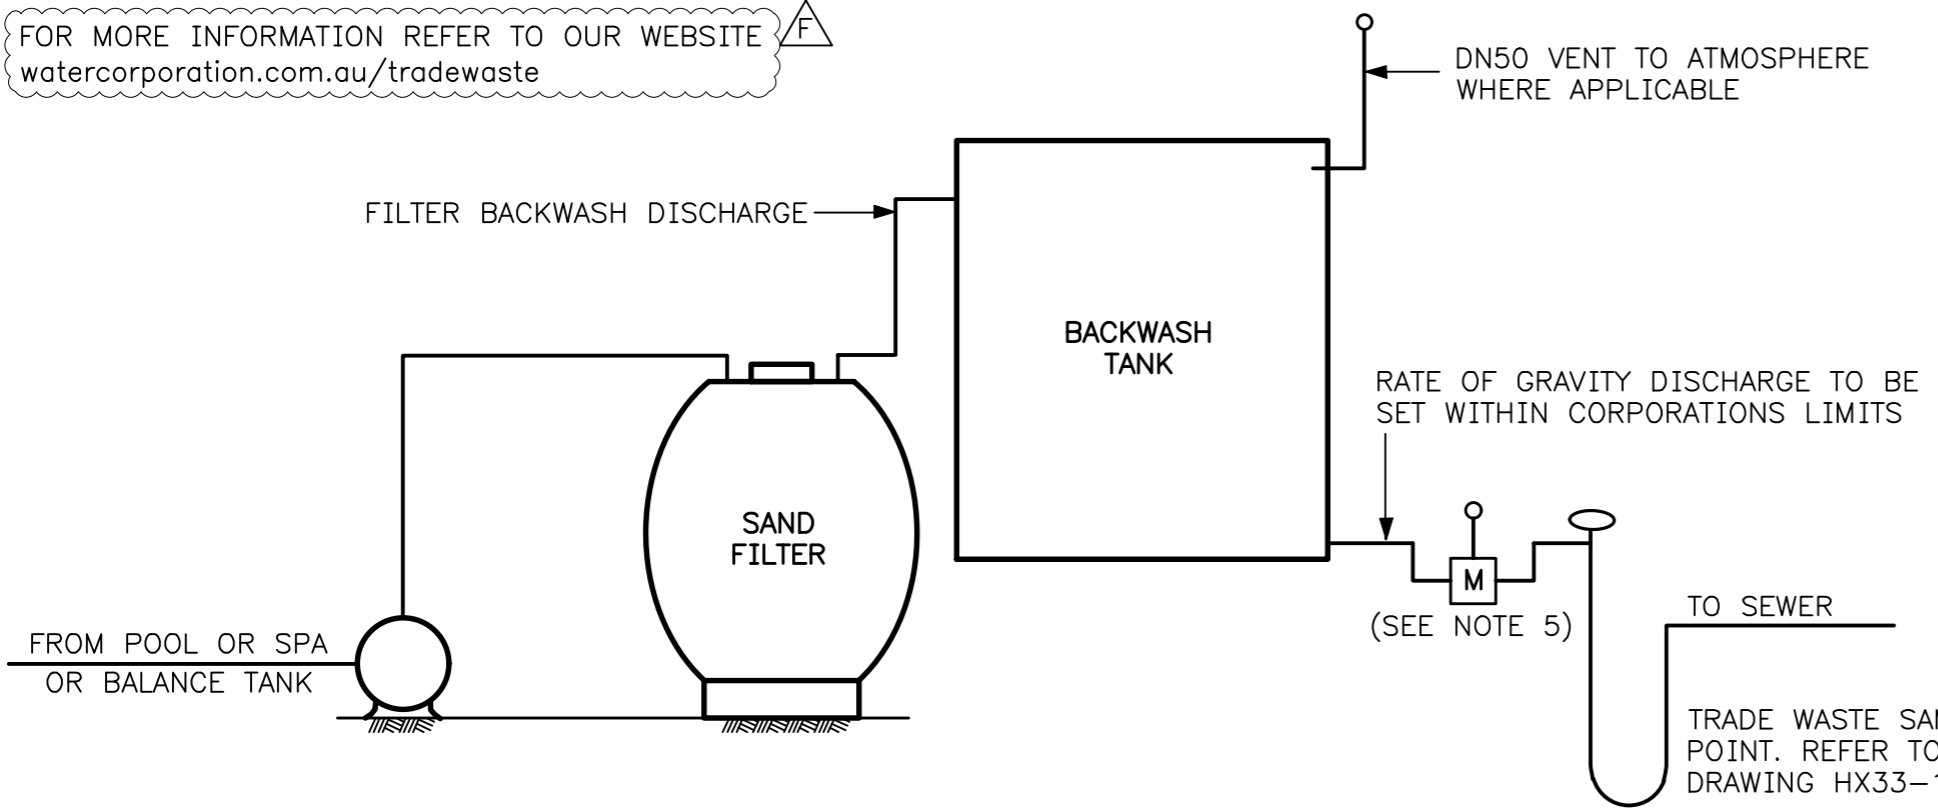

GUIDELINES

1. AN APPLICATION TO DISCHARGE TRADE WASTE IS REQUIRED FOR ALL AQUATIC FACILITIES.
2. THE DISCHARGE RATE TO SEWER NOT TO EXCEED THE CORPORATION'S CURRENT LIMITS.
3. THIS DRAWING TO BE USED IN CONJUNCTION WITH PUB20 – SWIMMING POOLS AND SPAS.
4. TRADE WASTE SAMPLE POINT TO BE MINIMUM DN100 AND IN ACCORDANCE WITH TYPICAL DRAWING HX33-11-30
5. INSTALLATION OF TRADE WASTE MONITORING POINT (REFER TYPICAL DRAWING HX33-20-00) MAY BE REQUIRED. CONTACT TRADE WASTE SECTION FOR ADVICE.
6. ALL MEASUREMENTS SHOWN ARE IN MILLIMETERS.
7. AIR ADMITTANCE VALVE SHALL NOT BE USED IN CONNECTION WITH TRADE WASTE PRE-TREATMENT FIXTURES.
8. ALL ASSOCIATED PLUMBING WORK IS TO COMPLY WITH THE PLUMBERS LICENSING AND PLUMBING STANDARDS REGULATIONS 2000 (THE PLUMBING REGULATIONS) (AS AMENDED)
9. TRADE WASTE SAMPLING POINT DESIGN, LOCATION AND ACCESSIBILITY MUST NOT CONSTITUTE A HEALTH & SAFETY RISK

F	05/2024		NOTE 9 ADDED, NOTE 8 UPDATED	JD	MT	MS
E	06/2019		REVISED AS CLOUDED PLUS DRAWING TITLE AMENDED TO AQUATIC FACILITESM SIGNATURES & TITLES AMENDED	DJ	ET	MS
D	07/2016		WEBSITE DETAILS ADDED, GUIDELINES AMENDED	RJ	SJ	MS
C	06/2009		NOTES 10 & 11 ADDED	RJ	GC	AM
B	12/2006		SETTLABLE SOLIDS ARRESTOR AMENDED	KLM	AM	VM
ISSUE	DATE	GRID	REVISION	DRN	REC	APPD

SCALE: DIAGRAMMATIC

DES CALC	RECOMMENDED	12/06/2019		WATER CORPORATION TYPICAL DRAWINGS FOR TRADE WASTE CONNECTION TO SEWER OF AQUATIC FACILITIES FORMERLY TYPICAL DRAWING 1830	ORIGINAL SHEET SIZE
DES CHD	E. TRISTANTO				A3
DRN A CLEAVER	SENIOR OFFICER – FIELD INVESTIGATIONS			WATER CORPORATION TYPICAL DRAWINGS FOR TRADE WASTE CONNECTION TO SEWER OF AQUATIC FACILITIES FORMERLY TYPICAL DRAWING 1830	A3
Q.C. CHD G CLEAVER	APPROVED	12/06/2019			
	M. STARK				
	MANAGER, COMMERCIAL & INDUSTRIAL SERVICES				
				FILE	PLAN
				PROJECT	HX33-18-30
				CAD	ISSUE
				F	MF