



INSTALLATION TYPE A

NO TRADE WASTE PERMIT REQUIRED.

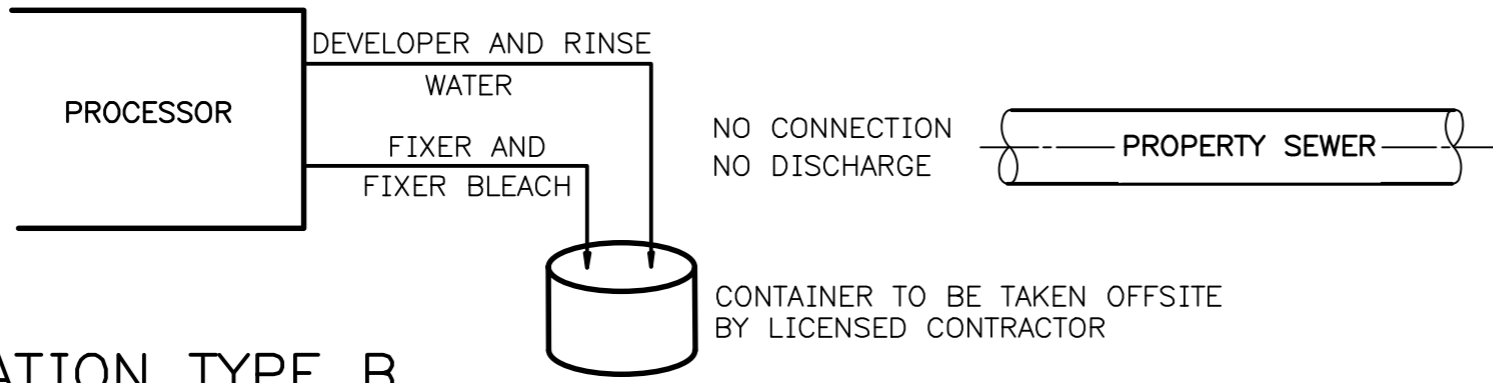


INSTALLATION TYPE B

APPLICATION TO DISCHARGE TRADE WASTE REQUIRED
TRADE WASTE PERMIT REQUIRED.

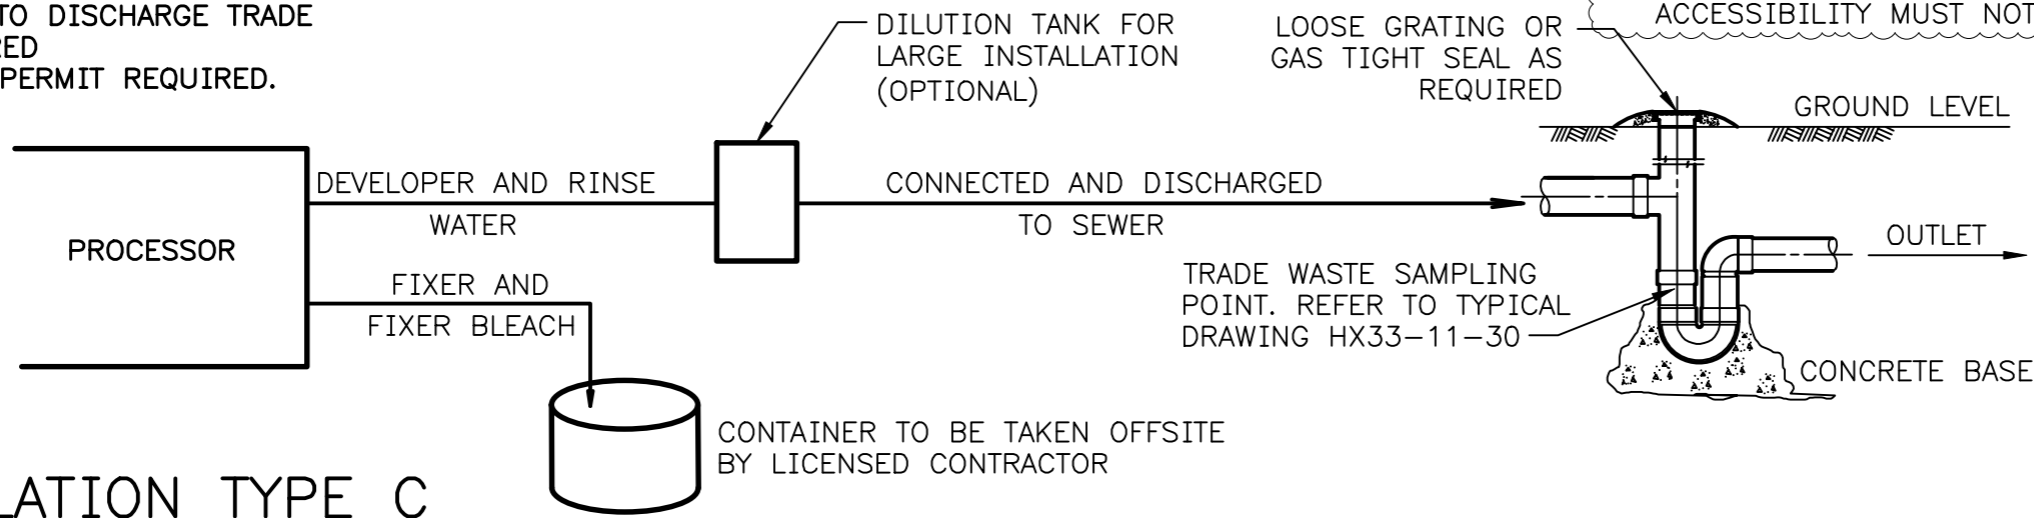

INSTALLATION TYPE C

APPLICATION TO DISCHARGE TRADE WASTE REQUIRED
TRADE WASTE PERMIT REQUIRED.

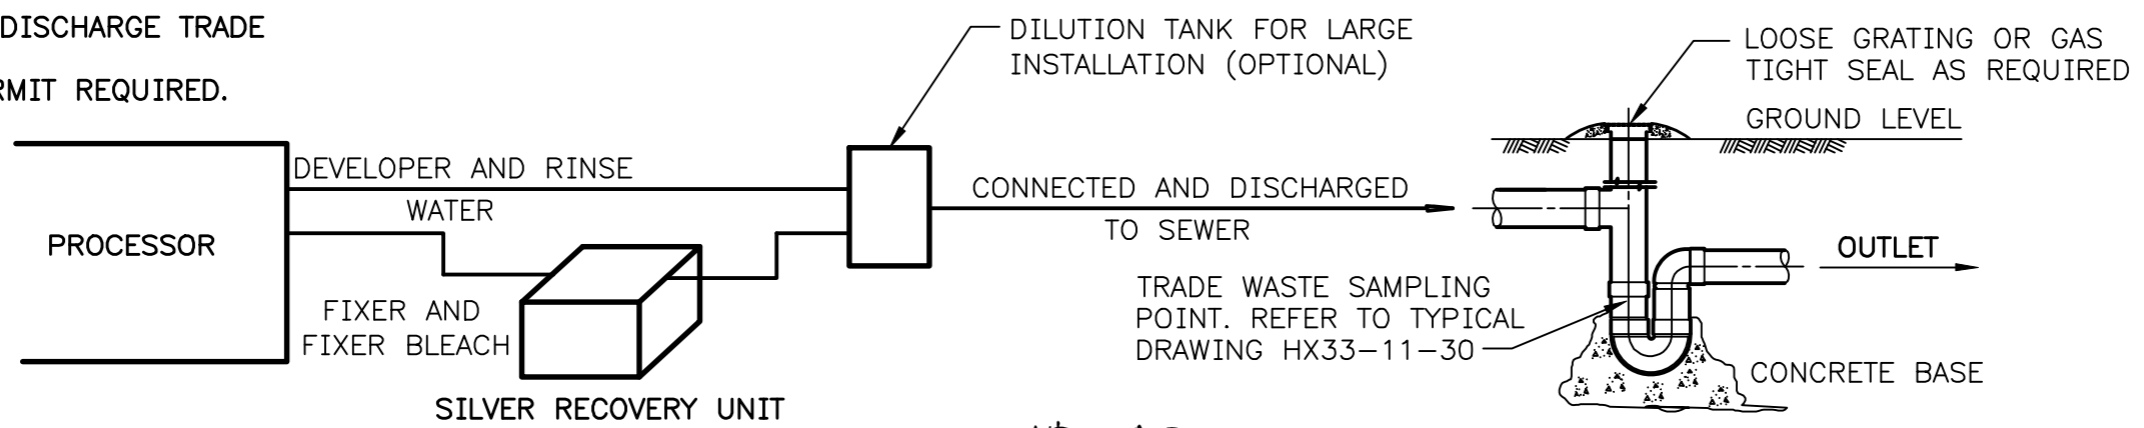

GUIDELINES

1. ONLY TYPE 'B' AND TYPE 'C' INSTALLATIONS REQUIRE AN APPLICATION TO DISCHARGE TRADE WASTE.
2. TRADE WASTE SAMPLE POINT TO BE MINIMUM DN100 IN ACCORDANCE WITH TYPICAL DRAWING HX33-11-30.
3. THIS DRAWING IS TO BE USED IN CONJUNCTION WITH PUB6 AND PUB27.
4. ALL MEASUREMENTS SHOWN ARE IN MILLIMETERS.
5. ALL ASSOCIATED PLUMBING WORK IS TO COMPLY WITH THE PLUMBERS LICENSING AND PLUMBING STANDARDS REGULATIONS 2000 (THE PLUMBING REGULATIONS) (AS AMENDED).
6. IF SAMPLE POINT IS LOCATED IN A DRIVEWAY AREA OR SUBJECT TO STORMWATER INTRUSION, THEN IT MUST BE SEALED AND VENTED IN ACCORDANCE WITH TYPICAL DRAWING HX33-10-10.
7. DILUTION TANK TO BE A WATER CORPORATION APPROVED PRODUCT. REFER WATER CORPORATION WEBSITE FOR LIST OF APPROVED PRODUCTS.
8. TRADE WASTE SAMPLING POINT DESIGN, LOCATION AND ACCESSIBILITY MUST NOT CONSTITUTE HEALTH & SAFETY RISK

E	05/2024		NOTE 8 ADDED, NOTE 1 AMENDED	JD	NT	MS
D	02/2020		DILUTION PIT ADDED, NOTE 4 UPDATED, NEW NOTES 6 & 7 ADDED. GENERAL UPDATES	JMS	NT	MS
C	07/2016		WEBSITE DETAILS ADDED, GUIDELINES AMENDED	BJ	SJ	MS
B	06/2009		NOTE 5 ADDED	RJ	GC	AM
ISSUE	DATE	GRID	REVISION	DRN	REC	APPD

FOR MORE INFORMATION REFER TO OUR WEBSITE watercorporation.com.au/tradewaste

SCALE: DIAGRAMMATIC

DES CALC	DES CHD	DRN A CLEAVER	Q.C. CHD G CLEAVER	RECOMMENDED 01/08/2005 A MANZINGER SENIOR ASSESSMENTS OFFICER	APPROVED 01/08/2005 J HEWITT MANAGER, INDUSTRIAL WASTES		WATER CORPORATION TYPICAL DRAWINGS FOR TRADE WASTE DISPOSAL OPTIONS FOR PHOTOGRAPHIC WASTE	ORIGINAL SHEET SIZE A3
				FILE 58584705	PLAN	PROJECT HX33-18-20		CAD ISSUE E
								MF