Docusign Envelope ID: CE8C938A-AB14-4161-9F78-586CD8B54458

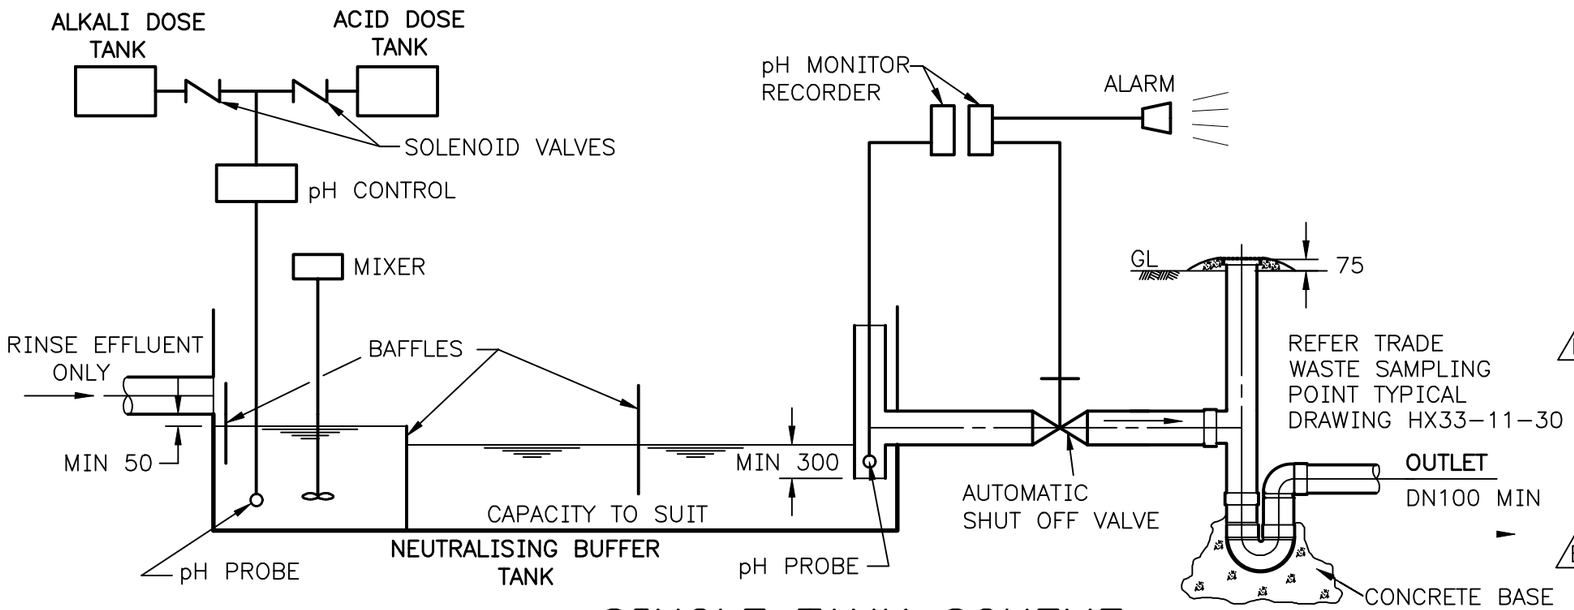

SINGLE TANK SCHEME

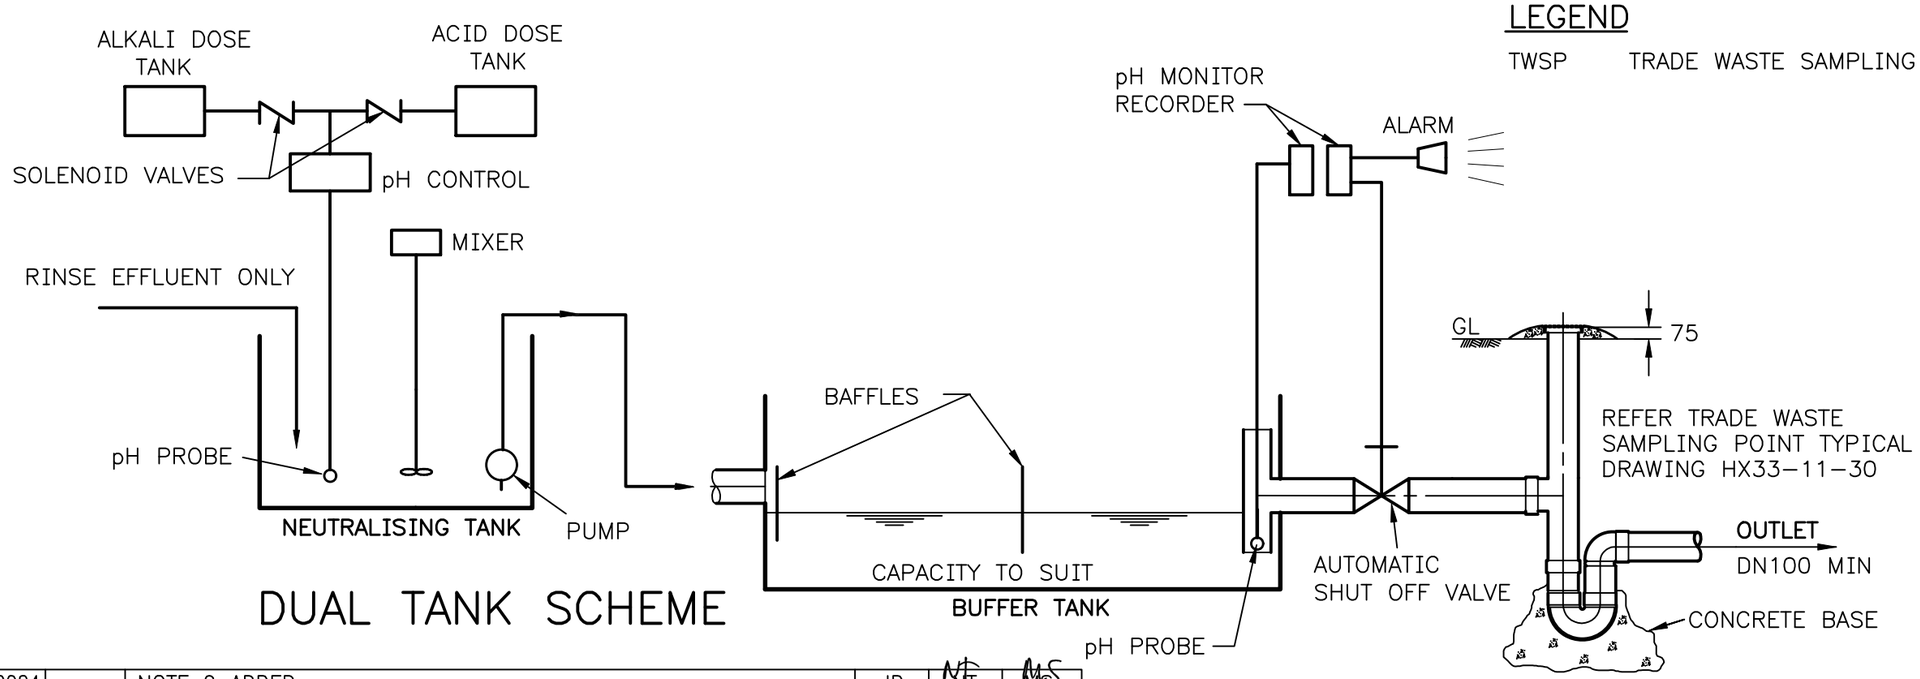

DUAL TANK SCHEME

GUIDELINES

1. AUTOMATIC VALVES AND pH PROBES MUST BE MAINTAINED TO MANUFACTURERS' SPECIFICATION.
2. ALL TANKS REQUIRE OVERFLOWS TO SELF-CONTAINED STORAGE.
3. THE INNER SURFACES OF THE TANKS TO BE CHEMICAL RESISTANT.
4. CONTROLLED PUMP OR GRAVITY DISCHARGE IS PERMITTED.
5. THE pH OF DISCHARGE MUST BE BETWEEN 6.0 AND 10.0.
6. ALL MEASUREMENTS SHOWN ARE IN MILLIMETRES.
7. E ALL ASSOCIATED PLUMBING WORK IS TO COMPLY WITH THE PLUMBERS LICENSING AND PLUMBING STANDARDS REGULATIONS 2000 (THE PLUMBING REGULATIONS) (AS AMENDED)
8. IF SAMPLE POINT IS LOCATED IN A DRIVEWAY AREA OR SUBJECT TO STORMWATER INTRUSION, THEN IT MUST BE SEALED AND VENTED IN ACCORDANCE WITH TYPICAL DRAWING HX33-10-10.
9. E TRADE WASTE SAMPLING POINT DESIGN, LOCATION AND ACCESSIBILITY MUST NOT CONSTITUTE A HEALTH & SAFETY RISK

LEGEND

TWSP TRADE WASTE SAMPLING POINT

ISSUE	DATE	GRID	REVISION	DRN	REC	APPD
E	05/2024		NOTE 9 ADDED	JD	NT NT	MS MS
D	02/2020		PLUMBING REGULATION TITLE UPDATED, NOTE 8 ADDED	JMS	NT	MS
C	07/2016		WEBSITE DETAILS ADDED, GUIDELINES AND LEGEND AMENDED	BJ	SJ	MS
B	06/2009		NOTE 8 ADDED	RJ	GC	AM

FOR MORE INFORMATION REFER TO OUR WEBSITE E
watercorporation.com.au/tradewaste

SCALE: DIAGRAMMATIC

DES CALC
DES CHD
DRN A CLEAVER
Q.C. CHD G CLEAVER

RECOMMENDED 01/08/2005
A MANZINGER
SENIOR ASSESSMENTS OFFICER

APPROVED 01/08/2005
J HEWITT
MANAGER, INDUSTRIAL WASTES

WATER CORPORATION

WATER CORPORATION
TYPICAL DRAWINGS FOR TRADE WASTE
NEUTRALISER UNIT

ORIGINAL SHEET SIZE A3

FILE 58536723
PLAN HX33-16-10
CAD
ISSUE E
PROJECT
MF

283
394

© THIS DRAWING IS THE PROPERTY OF THE WATER CORPORATION. IT SHALL NOT BE COPIED WITHOUT PERMISSION.

CAD MANAGEMENT_NOT READ ONLY\DRAFTING\PROJECTS\TRADE WASTE TYPE DRAWINGS\REVISION\HX33-016-010-01E 13:43 24/06/2024 DRUCEJ2/NB46087